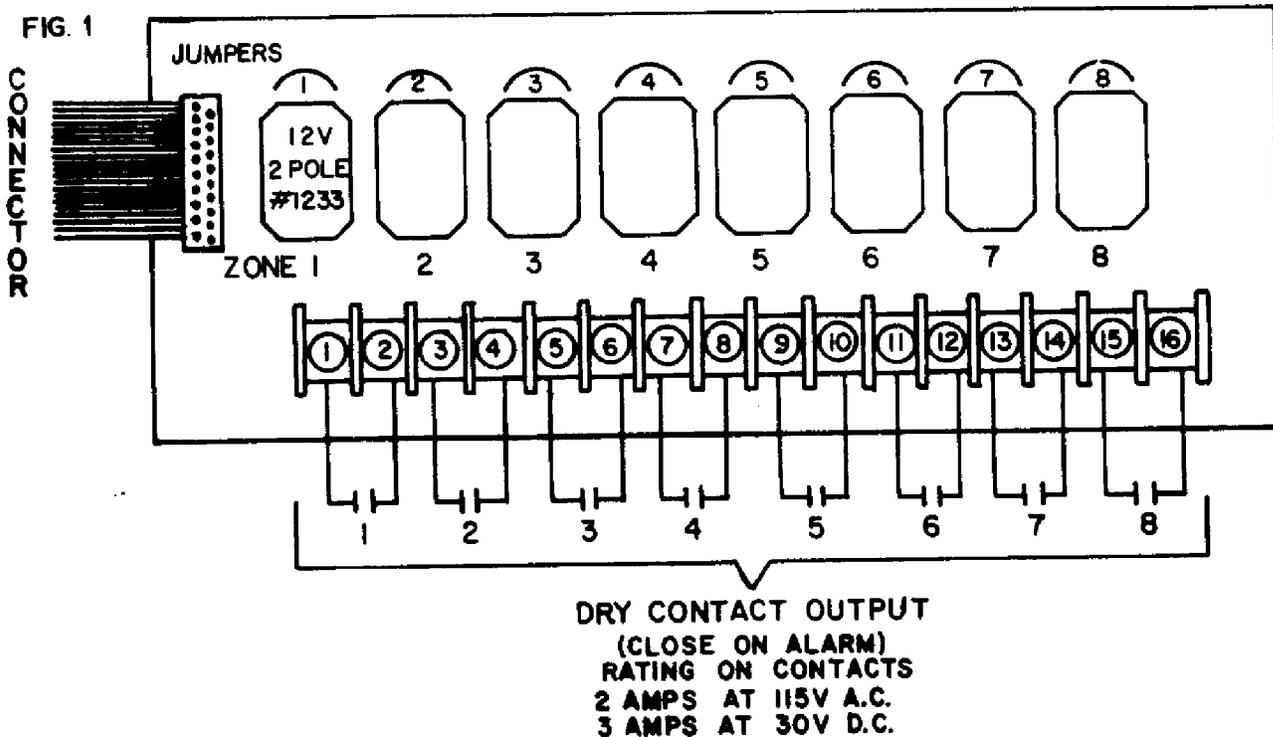


The Model 1041UL is an optional relay board that provides dry contacts, that close on alarm, for the eight individual zones.

The resetting of each relay after activation, is determined by a jumper located above that particular relay. If the jumper is left connected, as shipped, the relay will lock closed and have to be reset manually with the reset switch. If the jumper is cut, the relay will reset when the panel is disarmed.

A ribbon cable and hardware are provided for mounting in the 1040UL box and connecting to the P2 connector, as shown in FIG. 2.



**FIG. 2 MODEL 1041UL HOOK-UP TO MODEL 1040UL**

